


NOTES:

- 1) Install ground rod in pull box.
- 2) Maximum 2 conduits per fixture. 3 conduits require adjacent pull box.
- 3) Dissimilar metals separated dielectrically.
- 4) All bolts, nuts, washers, and hardware shall be galvanized steel.



NOTE - Infield borings in pole may only be in 90° increments in relation to hand hole.

Locate Handhole in minimum 36" clear space



VICTORIAN FLUTED POLE (wt. 500LBS)

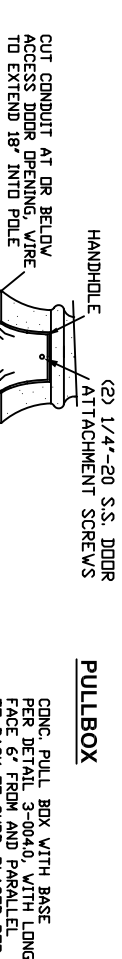


POLE ORIENTATIONS

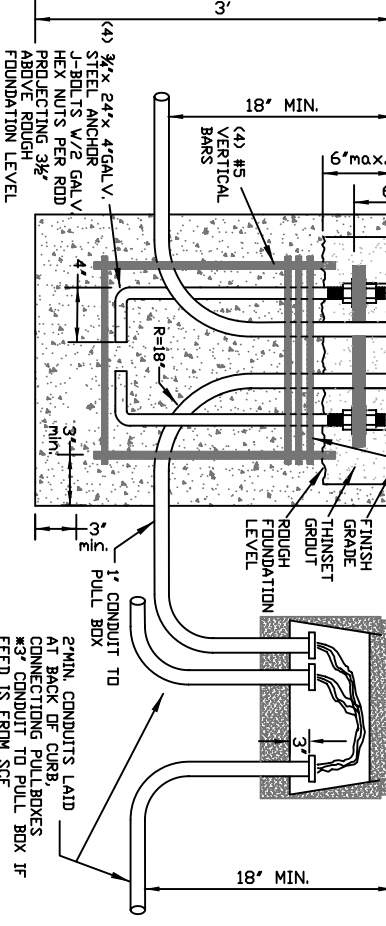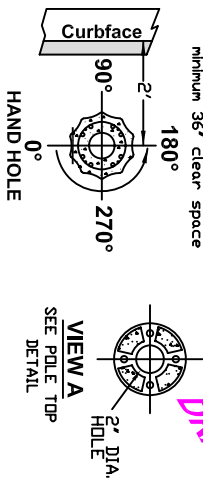

POLE TOP DETAIL

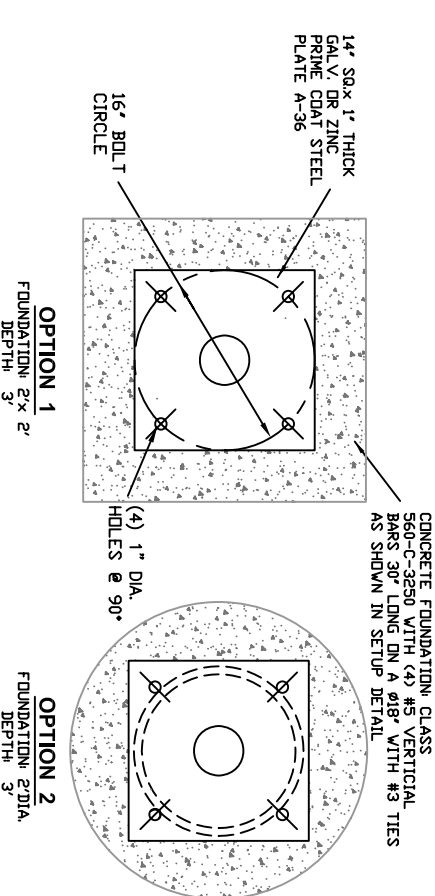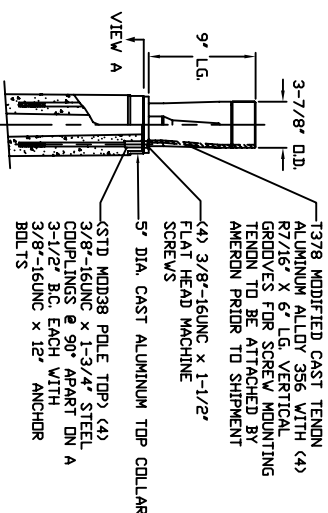


POLE SECTION

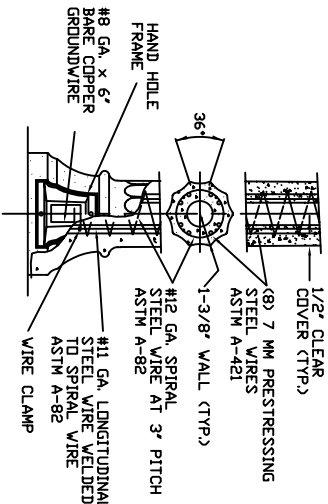

NOTES:

1. Contact: Pacific Lighting Sales Inc. 2366 Birchtree Drive, Suite 100 Lake Forest, CA 92630, (949) 597-1633, <http://www.pls-inc.com>
2. Order: Pole **VBFO4.7SPL**, Victorian Fluted Pole, Pole Mix (2P3S) Santa Barbara Black & White exposed aggregate finish, with flat water sealer coating - ASTM C-150 TYPE III gray cement.
3. Specify Tamper Proof Door Screws.
4. Baseplate is included.
5. (4) 3/4"x24"x4" galvanized steel bolts & hardware included.
6. MOD-BM: Plug down pole length to 14'-3" O.A.L.

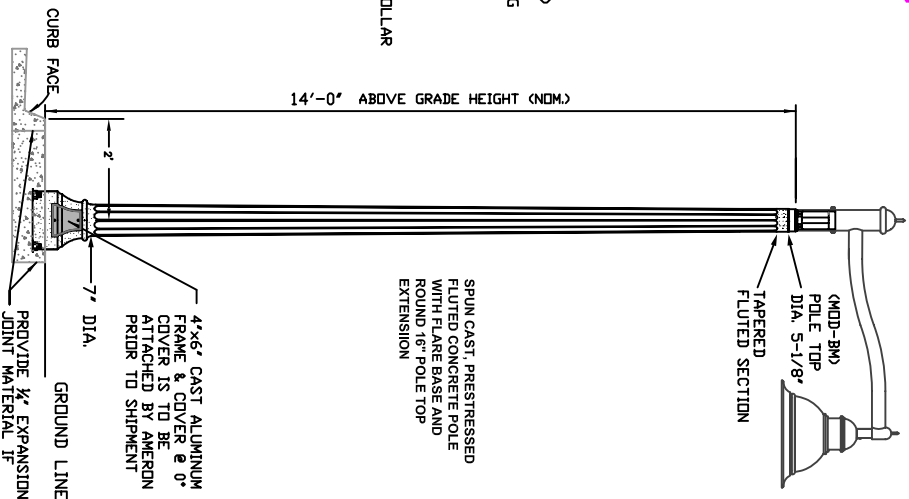

REVISED	DATE	APPROVED	CITY OF SANTA BARBARA – PUBLIC WORKS DEPARTMENT	STANDARD DETAIL
	JAN07		POLE STANDARD: TYPE C-08	
		PUBLIC WORKS DIRECTOR	DATE	3-003.0-08